

STRAINERS


Designed to ANSI B16.34 the strainer bodies are produced with a superior wallthickness for corrosion allowance.

Standard strainers are equipped with screens for the average service of most mediums (steam, gas, air, oil, chemicals , ect.).

The large screen open area ensures an efficient filtering action with a low pressure drop.

Filtering area to inlet area ratio is larger than 3 to 1 .
Screens are manufactured with perforated plate in the materials and with the perforation specified in the relevant tables .

Screens with different perforation (or wire mesh) and materials may be manufactured on request.

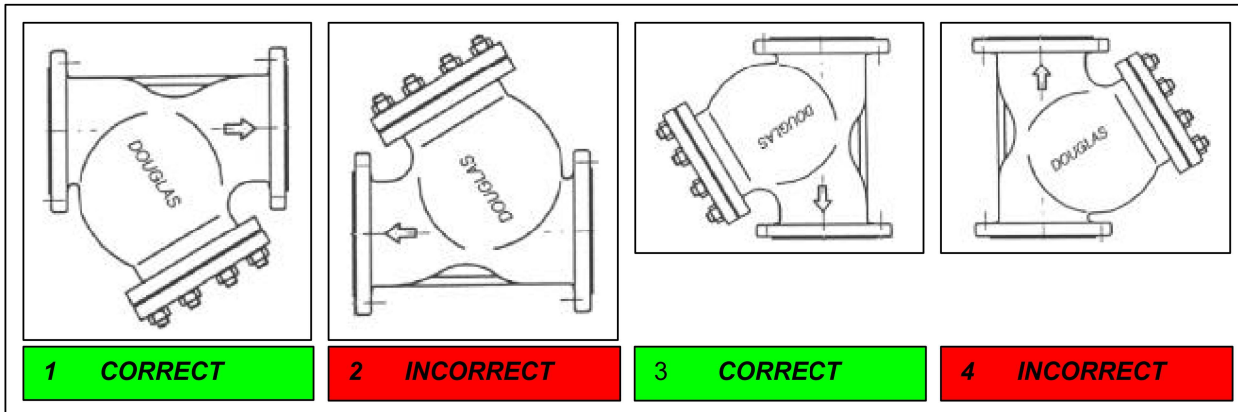
INSTALLATION


- All strainers should be mounted as close as possible to the valve or machinery which they are being installed to protect. It is important to ensure that the strainer installed with the flow following the same direction as the flow direction arrow cast onto the strainer body.
- For mounting in horizontal or inclined pipelines, ensure that the screen housing is always mounted below the pipeline.
- " Y " – strainers should never be installed in vertical pipelines in the upward flow condition. (see above)

SIZES

2"-3"-4"-6"-8"-10"-12"-14"-16"-18"-20"-24"


CONNECTIONS

Buttweld	ANSI B16.25
Flanged	ANSI B 16.5

LIMITING CONDITIONS (according to ISO 6552)

According to the body rating (ANSI B16.34)
C300 – ANSI 300
OTHER RATINGS ON REQUEST

CAST STEEL "Y" TYPE STRAINERS DOUGLAS C300 WCB


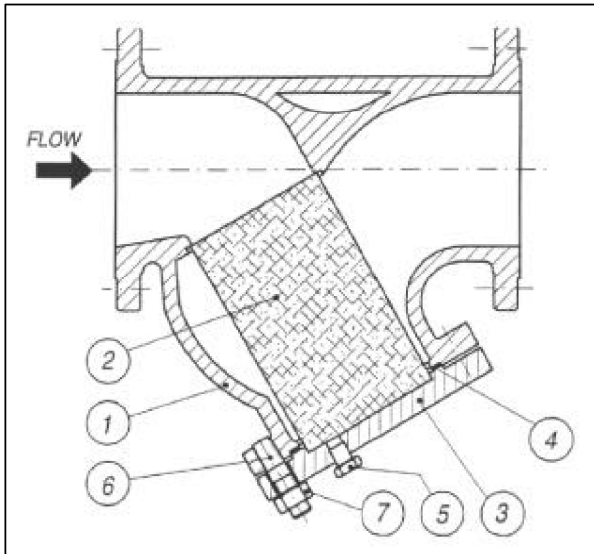


POS.	DESCRIPTION	MATERIALS	SPARES
1	Body	ASTM A216 WCB	
2	Screen	S.S. 304	X
3	Cover	ASTM A105	
4	Gasket	316 / GRAPHITE	X
5	Drain plug	ASTM A105	
6	Studs	ASTM A193 B7	
7	Nuts	ASTM A194 2H	

OTHER MATERIALS ON REQUEST

Size (inches)	2"	3"	4"	6"	8"	10"	12"	14"	16"	18"	20"	24"
SRF	267	318	356	445	559	622	711	838	864	978	1016	1346
S	267	318	356	445	559	622	711	838	864	978	1016	1346
H	175	240	330	380	500	625	740	805	920	1025	1140	1360
H1	250	275	360	470	575	920	1100	1200	1360	1350	1700	2050
Kg	20	45	65	105	180	254	430	670	750	863	1125	1625

STANDARD PERFORATIONS 1.5 mm
SPECIAL PERFORATIONS ON REQUEST . DRAIN PLUG SIZE 3/4"
Dimension : SRF , S , H , H1 are in millimeters (mm)

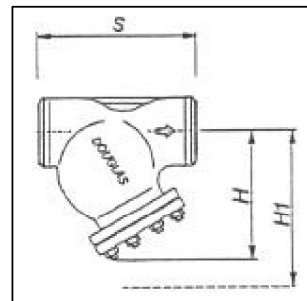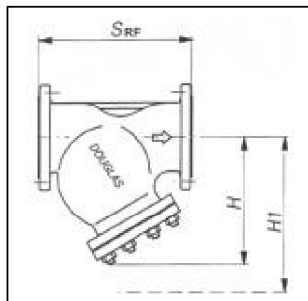

HOW TO SERVICE

Strainer maintenance should be made at least once year, or whenever the pressure drop is found to be in excess of the normal figures. A quick clean-up system, to made approximately once a month, is to blow-off small impurities through the drain-plug (5). It is recommended to install a drain valve by a nipple to the drain hole to speed-up this operation. For a complete maintenance follow the points herebelow: **-1-** Be sure that the main line has been shut-off. **-2-** Untighten cover stud bolts (6) and nuts (7) and remove cover (3) and gasket (4). **-3-** Withdraw screen (2) and carefully inspect it for damages. If any hole in the screen is found abstracted, clean it with compressed air and / or any suitable tool. If the screen is broken in any part or out of shape, replace it with a new spare one. **Never reinstall a broken or distorted screen.** **-4-** Carefully clean the inside of the strainer body. **-5-** Fit a new gasket (4). **-6-** Install the new screen or the cleaned one (2). Be sure to center the screen in the upper seat. **-7-** Put in place cover (3). Be sure that drain plug (5) is closed. **-8-** Slowly give pressure to the line, checking for leakages. **9-** Write on the strainer body the date of this maintenance operation.

How to order: i.e. C300 WCB / 304 F 1.5 2" 300 RF

DOUGLAS ITALIA S.p.A Località Pradaglie – 29013 CARPANETO PIACENTINO (PC)

OFFICIAL WEB SITE: www.douglas-italia.com